

REPORT OF PERFORMANCE**1080-15**

OBJECT	Three-core heat-shrinkable indoor termination
TYPE	GTM -IXAS- 1233H3A (GXE -13) 6,35/11 (12) kV – 3x185 mm ² – Al – XLPE
CLIENT	Gala Shrink Fit, Mumbai, India
MANUFACTURER	Gala Shrink Fit, Mumbai, India
TESTED BY	KEMA Nederland B.V. Arnhem, The Netherlands
DATE OF TESTS	12 August 2014 to 10 February 2015
TEST SPECIFICATION	The programme was based on IEC 60502-4 (2010), test sequence 1.1, 1.2, and 1.4.
SUMMARY AND CONCLUSION	The indoor termination passed the electrical and non- electrical tests. During the examination of the indoor terminations after the humidity test, loss of dielectric quality due to tracking erosion and some splitting of the material was found on the break-out.

This report applies only to the object tested. The responsibility for conformity of any object having the same type references as that tested rests with the manufacturer.

This report consists of 68 pages in total.

Copyright: Only integral reproduction of this report is permitted without written permission from KEMA. Electronic copies in e.g. PDF-format or scanned version of this report may be available and have the status "for information only". The sealed and bound version of the report is the only valid version.

KEMA Nederland B.V.



S.A.M. Verhoeven
Director Testing, Inspections &
Certification The Netherlands

Arnhem, 6 May 2015

CONTENTS

	page
1	Identification of the object tested 4
1.1	Ratings/characteristics of the object tested and proved by tests 4
1.2	Characteristics of the indoor termination for cables with extruded insulation 4
1.3	Characteristics of the test cable 4
1.4	List of drawings 7
2	General information 8
2.1	The tests were witnessed by 8
2.2	The tests were carried out by 8
2.3	Measurement uncertainty 8
3	Test sequence 1.1 for indoor termination (two terminations) 9
3.1	Test arrangement 9
3.1.1	Determination of the cable conductor temperature 9
3.2	Photograph of test set-up 10
4	Test sequence 1.1 11
4.1	DC voltage dry 11
4.2	AC voltage dry 12
4.3	Partial discharge at ambient temperature 13
4.4	Impulse voltage at elevated temperature 14
4.5	Heating cycle voltage in air 22
4.6	Partial discharge at elevated and ambient temperature 23
4.6.1	Partial discharge at elevated temperature 23
4.6.2	Partial discharge at ambient temperature 24
4.7	Impulse voltage at ambient temperature 25
4.8	AC voltage dry 33
4.9	Examination 34
4.9.1	Photographs 35
5	Test sequence 1.2 for indoor termination (one termination) 37
5.1	Test arrangement 37
5.1.1	Determination of the cable conductor temperature 37
5.2	DC voltage dry 38
5.3	AC voltage dry 39
5.4	Thermal short circuit test (screen) 40
5.5	Thermal short circuit test (conductor) 43
5.6	Test results and oscillograms 45
5.7	Condition / inspection after test 47
5.8	Impulse voltage at ambient temperature 50
5.9	AC voltage dry 58
5.10	Examination 59
5.10.1	Photographs 60

6	Test sequence 1.4 (one indoor termination)	62
6.1	Humidity	62
6.1.1	Photographs	63
7	Drawing	67
8	Measurement uncertainty	68

1 IDENTIFICATION OF THE OBJECT TESTED

1.1 Ratings/characteristics of the object tested and proved by tests

Rated voltage, U_0/U (U_m)	6,35/11 (12) kV
Rated maximum conductor temperature in normal operation	90 °C
Rated conductor cross-section	3x185 mm ²
Thermal short-circuit current	22,5 kA

1.2 Characteristics of the indoor termination for cables with extruded insulation

Manufacturer	Gala Shrink Fit
Type	heat-shrinkable indoor termination
Type designation, reference number	GTM -IXAS- 1233H3A, (GXE -13)
Year of manufacture	2014
Rated voltage, U_0/U (U_m)	6,35/11 (12) kV
No. of cores	3
Dynamic short-circuit current	not applicable
Creepage distance (minimum)	450 mm
Flashover distance (minimum)	20 mm
Number of sheds	0
Material of insulating body	heat-shrinkable cross linked polyolefin anti-tracking material
Type of stress control	stress control mastic

1.3 Characteristics of the test cable

Note: the cable is not part of the type test.

Manufacturer (as stated by the client)	Apar Industries Limited, India
Type	$U_0 = 6$ kV 3x185 mm ² Al/XLPE/CTS/PVC/SWA/PVC (A2XCEWY) CABLE
Manufacturing year	2014
Rated voltage, U_0/U (U_m)	6/10 (12) kV
No. of cores	3
Core identification	core 1 = red core 2 = yellow core 3 = blue
Marking on the oversheath	AIL/UNIT: UNIFLEX CABLES- INDIA 'UNICAB' 6/10 (12) KV XLPE CABLE '3X185 Sq.mm 2014
Construction	see List of drawings

.Conductor

- material aluminium
- cross-section 185 mm²
- nominal diameter 16,2 mm
- type stranded circular compacted
- maximum conductor temperature in normal operation 90 °C
- presence and nature of measures to achieve longitudinal watertightness no

.Conductor screen

- material extruded semi-conducting
- nominal thickness 0,6 mm
- material designation extruded semi-conducting compound
- manufacturer of the material Hanwha and Sakun Polymer

.Insulation

- material XLPE
- nominal thickness 3,4 mm

.Insulation (core) screen

- material extruded semi-conducting compound
- strippable yes
- nominal thickness 0,5 mm

.Metal screen

- material two annealed plain copper tape
- type helical
- nominal thickness and width of tape 0,03 x 40 mm (overlap 10%)
- nominal thickness and width of tape 2 x 40 mm (overlap 10%)
- cross-sectional area 27,6 mm² three cores together

.Inner coverings and fillers

- material yes

.Separation sheath

- material PVC, type ST₂
- nominal thickness 1,6 mm
- manufacturer of the material Gala Shrink Fit, Mumbai, India

.Metal armour

- material galvanised steel round wires
- number of wires 68
- nominal diameter of wires 2,5 mm
- cross-sectional area 333,8 mm²

.Metal foil or tape, longitudinally applied, no bonded to the oversheath

.Oversheath

- material PVC, type ST₂
- nominal thickness 3,3 mm
- nominal overall diameter of the cable (D) 72,0 mm
- material designation PVC, type ST2
- manufacturer of the material Gala Shrink Fit, Mumbai, India
- colour black

.Manufacturing details insulation system

- location of manufacturing Umbergaon, India
- type of extrusion line CCV
- type of extrusion triple common extrusion
- curing means dry
- cooling means dry
- manufacturing length (where cable sample for testing has been taken from) 100 m

1.4 List of drawings

The manufacturer has guaranteed that the object submitted for tests has been manufactured in accordance with the following drawing and documents. KEMA has verified that these drawing and documents adequately represent the object tested. The manufacturer is responsible for the correctness of these drawing and documents and the technical data presented.

The following drawing and documents have been included in this Report:

Drawing No./document No.	Revision
GTSPL/K02/06/14	00

The following document is only listed for reference and is kept in KEMA's files:

Document no.	Revision/date
Components list GTM/OXAS/1233A	-
Indoor termination GTM/XAS/31115	-

2 GENERAL INFORMATION

2.1 The tests were witnessed by

Name	Company
Mr Gurubax Singh 12 August to 15 August 2014	Gala Shrink Fit, Mumbai, India

2.2 The tests were carried out by

Name	Company
Ms H. He	KEMA Nederland B.V.,
Mr A. Sengers	Arnhem, The Netherlands
Mr T. Ariaans	
Mr E. Pultrum	
Mr D. Bouchier	
Mr N. Dobbe	
Mr K. Linden	

2.3 Measurement uncertainty

A table with measurement uncertainties is enclosed in this report. Unless otherwise stated, the measurement uncertainties of the results presented in this report are as indicated in that table.

3 TEST SEQUENCE 1.1 FOR INDOOR TERMINATION (TWO TERMINATIONS)

3.1 Test arrangement

3.1.1 Determination of the cable conductor temperature


Standard

Standard IEC 60840, Annex A, Subclause A.3.1 was used as a guide

For the tests at elevated temperature, a reference loop for temperature control of the conductor was installed and conductor current was used for heating. The reference cable was cut from the total cable length intended for the type test. This reference loop was installed close to the main loop in order to create the same environmental conditions as for the test loop.

The heating currents in both the reference loop and the test loop were kept equal at all times, thus the conductor temperature of the reference loop is representative for the conductor temperature of the test loop. IEC 60840, Annex A was used as a guide and IEC 60840, Subclause A.3.1, method 1 was applied.

The tests at elevated temperature are carried out after the conductor temperature has been within the stated temperature limits for at least 2 hours. The test set-up was consisting of a joint as part of a cable system, also incorporating two outdoor terminations which are not part of the type test objects. The test set-up of two separate main test loops connected in series.

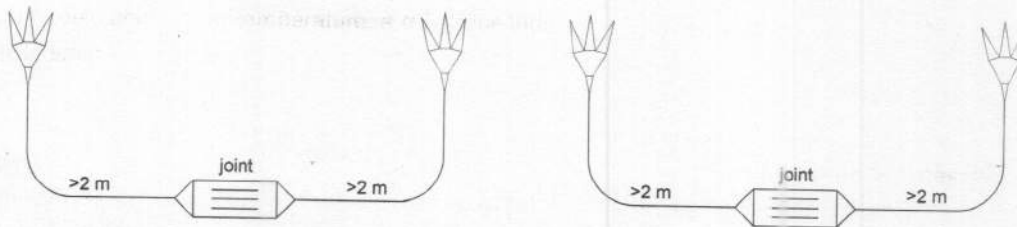

Sample 1 and 2 for test sequence 1.1

4 TEST SEQUENCE 1.1

4.1 DC voltage dry

Standard and date

Standard IEC 60502-4, Table 5, test number 1

Test date 12 August 2014

Environmental conditions

Ambient temperature 21 °C

Temperature of test object 21 °C

Testing arrangement		Voltage applied, DC		Duration (min)
Voltage applied to	Earth connected to	... x U ₀	(kV)	
Conductor 1,2 and 3 of test loop 1	Metal screens	6	38	15
Conductor 1,2 and 3 of test loop 2	Metal screens	6	38	15

Note

On request of the client the test has been performed more severely at 6 x U₀ instead of 4 x U₀.

Requirement

No breakdown or flashover shall occur.

Result

The object passed the test.

4.2 AC voltage dry

Standard and date

Standard IEC 60502-4, Table 5, test number 1

Test date 12 August 2014

Environmental conditions

Ambient temperature 21 °C

Temperature of test object 22 °C

Testing arrangement		Voltage applied, 50 Hz		Duration (min)
Voltage applied to	Earth connected to	... x U ₀	(kV)	
Conductor 1,2 and 3 of test loop 1	Metal screens	4,5	28,5	5
Conductor 1,2 and 3 of test loop 2	Metal screens	4,5	28,5	5

Requirement

No breakdown or flashover shall occur.

Result

The object passed the test.

4.3 Partial discharge at ambient temperature

Standard and date

Standard IEC 60502-4, Table 5, test number 2
 Test date 13 August 2014

Environmental conditions

Ambient temperature 22 °C

Characteristic test data

Temperature of test object 22 °C
 Circuit direct
 Calibration 5 pC
 Noise level at 1,73 U₀ 2,5 pC
 Declared sensitivity 5 pC
 Required sensitivity ≤ 5 pC
 Centre frequency 117,5 kHz
 Bandwidth (Δf) 100 kHz
 Test frequency 50 Hz
 Coupling capacitor 2600 pF

Core	Voltage applied, 50 Hz		Duration (s)	Partial discharge level (pC)
	... x U ₀	(kV)		
1 of test loop 1	2	12,5	10	-
	1,73	11	-	Not detectable
2 of test loop 1	2	12,5	10	-
	1,73	11	-	Not detectable
3 of test loop 1	2	12,5	10	-
	1,73	11	-	Not detectable
1 of test loop 2	2	12,5	10	-
	1,73	11	-	Not detectable
2 of test loop 2	2	12,5	10	-
	1,73	11	-	Not detectable
3 of test loop 2	2	12,5	10	-
	1,73	11	-	Not detectable

Requirement

The maximum partial discharge level from the test object at 1,73 U₀ shall not exceed 10 pC.

Result

The object passed the test.

4.4 Impulse voltage at elevated temperature

Standard and date

Standard IEC 60502-4, Table 5, test number 3
 Test date 26 August 2014

Environmental conditions

Ambient temperature 21 °C

Characteristic test data

Temperature of test object 97 °C
 Specified test voltage 95 kV

Testing arrangement		Polarity	Voltage applied (% of test voltage)	No. of impulses	See figure on next pages
Voltage applied to	Earthed				
Conductor 1 test loop 1 and 2	Metal screens and conductor 2 and 3	Positive	50	1	1 (waveshape)
			65	1	2
			80	1	2
			100	10	3 and 4
Conductor 1 test loop 1 and 2	Metal screens and conductor 2 and 3	Negative	50	1	5 (waveshape)
			65	1	6
			80	1	6
			100	10	7 and 8
Conductor 2 test loop 1 and 2	Metal screens and conductor 1 and 3	Positive	50	1	9 (waveshape)
			65	1	10
			80	1	10
			100	10	11 and 12
Conductor 2 test loop 1 and 2	Metal screens and conductor 1 and 3	Negative	50	1	13(waveshape)
			65	1	14
			80	1	14
			100	10	15 and 16
Conductor 3 test loop 1 and 2	Metal screens and conductor 1 and 2	Positive	50	1	17 (waveshape)
			65	1	18
			80	1	18
			100	10	19 and 20
Conductor 3 test loop 1 and 2	Metal screens and conductor 1 and 2	Negative	50	1	21 (waveshape)
			65	1	22
			80	1	22
			100	10	23 and 24

Note

On request of the client the applied LI voltage was 95 kV instead of 75 kV.

Requirement

Each core of the cable and accessory shall withstand without failure 10 positive and 10 negative voltage impulses.

Result

The object passed the test.

4.5 Heating cycle voltage in air

Standard and date

Standard IEC 60502-4, Table 5, test number 4

Test dates 28 August to 9 October 2014

Environmental conditions

Ambient temperature 20-22 °C

Characteristic test data

Heating method conductor current

Stabilized temperature 97 °C

No. of heating cycles	Required steady conductor temperature (°C)	Heating current during steady condition (A)	Heating cycle			Voltage	
			Heating		Cooling	Total duration (h)	Voltage applied 2,5 U ₀ (kV)
			Total duration (h)	Duration of conductor at steady temperature (h)	Total duration (h)		
126	95-100	approx. 409	5	2	4	9	16

Note

On request of the client the applied number of heating cycles was 126 instead of 60.

Requirement

No breakdown shall occur.

Result

The object passed the test.

4.6 Partial discharge at elevated and ambient temperature

4.6.1 Partial discharge at elevated temperature

Standard and date

Standard IEC 60502-4, Table 5, test number 6

Test date 11 November 2014

Environmental conditions

Ambient temperature 20 °C

Characteristic test data

Temperature of test object 97 °C
 Circuit direct
 Calibration 5 pC
 Noise level at 1,73 U₀ 2 pC
 Declared sensitivity 4 pC
 Required sensitivity ≤ 5 pC
 Centre frequency 98 kHz
 Bandwidth (Δf) 100 kHz
 Test frequency 50 Hz
 Coupling capacitor 2600 pF

Core	Voltage applied, 50 Hz		Duration (s)	Partial discharge level (pC)
	... x U ₀	(kV)		
1 of test loop 1 and 2	2	12,5	10	-
	1,73	11	-	Not detectable
2 of test loop 1 and 2	2	12,5	10	-
	1,73	11	-	Not detectable
3 of test loop 1 and 2	2	12,5	10	-
	1,73	11	-	Not detectable

Requirement

The maximum partial discharge level from the test object at 1,73 U₀ shall not exceed 10 pC.

Result

The object passed the test.

4.6.2 Partial discharge at ambient temperature

Standard and date

Standard IEC 60502-4, Table 5, test number 6
 Test date 13 November 2014

Environmental conditions

Ambient temperature 20 °C

Characteristic test data

Temperature of test object 20 °C
 Circuit direct
 Calibration 5 pC
 Noise level at 1,73 U₀ 2,5 pC
 Declared sensitivity 5 pC
 Required sensitivity ≤ 5 pC
 Centre frequency 124,5 kHz
 Bandwidth (Δf) 100 kHz
 Test frequency 50 Hz
 Coupling capacitor 2600 pF

Core	Voltage applied, 50 Hz		Duration (s)	Partial discharge level (pC)
	... x U ₀	(kV)		
1 of test loop 1 and 2	2	12,5	10	-
	1,73	11	-	Not detectable
2 of test loop 1 and 2	2	12,5	10	-
	1,73	11	-	Not detectable
3 of test loop 1 and 2	2	12,5	10	-
	1,73	11	-	Not detectable

Requirement

The maximum partial discharge level from the test object at 1,73 U₀ shall not exceed 10 pC.

Result

The object passed the test.

4.7 Impulse voltage at ambient temperature

Standard and date

Standard IEC 60502-4, Table 5, test number 10

Test date 14 November 2014

Environmental conditions

Ambient temperature 20 °C

Characteristic test data

Temperature of test object 20 °C

Specified test voltage 95 kV

Testing arrangement		Polarity	Voltage applied (% of test voltage)	No. of impulses	See figure on next pages
Voltage applied to	Earthed				
Conductor 1 of test loop 1 and 2	Metal screens and conductor 2 and 3	Positive	50	1	1 (waveshape)
			65	1	2
			80	1	2
			100	10	3 and 4
Conductor 1 of test loop 1 and 2	Metal screens and conductor 2 and 3	Negative	50	1	5 (waveshape)
			65	1	6
			80	1	6
			100	10	7 and 8
Conductor 2 of test loop 1 and 2	Metal screens and conductor 1 and 3	Positive	50	1	9 (waveshape)
			65	1	10
			80	1	10
			100	10	11 and 12
Conductor 2 of test loop 1 and 2	Metal screens and conductor 1 and 3	Negative	50	1	13 (waveshape)
			65	1	14
			80	1	14
			100	10	15 and 16
Conductor 3 of test loop 1 and 2	Metal screens and conductor 1 and 2	Positive	50	1	17(waveshape)
			65	1	18
			80	1	18
			100	10	19 and 20
Conductor 3 of test loop 1 and 2	Metal screens and conductor 1 and 2	Negative	50	1	21 (waveshape)
			65	1	22
			80	1	22
			100	10	23 and 24

Note

On request of the client the applied LI voltage was 95 kV instead of 75 kV.

Requirement

Each core of the cable and accessory shall withstand without failure 10 positive and 10 negative voltage impulses.

Result

The object passed the test.

4.8 AC voltage dry

Standard and date

Standard IEC 60502-4, Table 5, test number 11
Test date 17 November 2014

Environmental conditions

Ambient temperature 20 °C
Temperature of test object 20 °C

Testing arrangement		Voltage applied, 50 Hz		Duration (min)
Voltage applied to	Earth connected to	... x U ₀	(kV)	
Conductor 1,2 and 3 of test loop 1 and 2	Metal screens	2,5	16	15

Requirement

No breakdown or flashover shall occur.

Result

The object passed the test.

4.9 Examination

Standard and date

Standard IEC 60502-4, Table 5, test number 14

Test date 1 December 2014

Environmental conditions

Ambient temperature 21 °C

Temperature of test object 21 °C

Test loop	Observations ¹⁾
1 and 2	None of the following has been detected: <ul style="list-style-type: none">- cracking in the filling media and/or tape or tube components- a moisture path across a primary seal- corrosion and/or tracking and/or erosion- leakage of any insulating material
1) Photographs of the examination are presented on the next page	

Result

The results are for information only.

5 **TEST SEQUENCE 1.2 FOR INDOOR TERMINATION
(ONE TERMINATION)**

5.1 **Test arrangement**

5.1.1 **Determination of the cable conductor temperature**


Standard

Standard IEC 60840, Annex A, Subclause A.3.1 was used as a guide

For the tests at elevated temperature, a reference loop for temperature control of the conductor was installed and conductor current was used for heating. The reference cable was cut from the total cable length intended for the type test. This reference loop was installed close to the main loop in order to create the same environmental conditions as for the test loop.

The heating currents in both the reference loop and the test loop were kept equal at all times, thus the conductor temperature of the reference loop is representative for the conductor temperature of the test loop. IEC 60840, Annex A was used as a guide and IEC 60840, Subclause A.3.1, method 1 was applied.

The tests at elevated temperature are carried out after the conductor temperature has been within the stated temperature limits for at least 2 hours. The test set-up was consisting of a joint as part of a cable system, also incorporating a heat shrinkable outdoor termination and a heat shrinkable indoor termination.

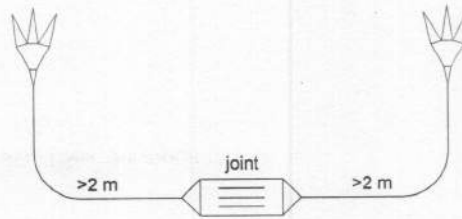

Sample 3 for test sequence 1.2

5.2 DC voltage dry

Standard and date

Standard IEC 60502-4, Table 5, test number 1
 Test date 12 August 2014

Environmental conditions

Ambient temperature 21 °C
 Temperature of test object 22 °C

Testing arrangement		Voltage applied, DC		Duration (min)
Voltage applied to	Earth connected to	... x U ₀	(kV)	
Conductor 1,2 and 3 of test loop 3	Metal screens	6	38	15

Note

On request of the client the test has been performed more severely at 6 x U₀ instead of 4 x U₀.

Requirement

No breakdown or flashover shall occur.

Result

The object passed the test.

5.3 AC voltage dry

Standard and date

Standard IEC 60502-4, Table 5, test number 1

Test date 12 August 2014

Environmental conditions

Ambient temperature 21 °C

Temperature of test object 22 °C

Testing arrangement		Voltage applied, 50 Hz		Duration (min)
Voltage applied to	Earth connected to	... x U ₀	(kV)	
Conductor 1,2 and 3 of test loop 3	Metal screens	4,5	28,5	5

Requirement

No breakdown or flashover shall occur.

Result

The object passed the test.

5.4 Thermal short circuit test (screen)

Standard and date

Standard IEC 60502-4, Table 5, test number 7
 Test date 9 January 2015

Environmental conditions

Ambient temperature 22 °C

Characteristic test data

Stabilized conductor temperature 97 °C

Conductor heating		
Required conductor temperature θ (°C)	Applied 3-phase heating current (A)	Conductor stable at 97 °C before short-circuit application (h)
$95 \leq \theta \leq 100$	530	2

Short-circuit application on screen (see figures on the next pages)			
Specified short-circuit current (kA)	Frequency (Hz)	Duration (s)	Number of short-circuit applications
2,5	50	1	2

Procedure

The conductor temperature shall be maintained within the stated temperature limits for at least 2 h before carrying out the short-circuit test. Between the two short-circuit applications, the cable screen shall be allowed to cool down to a temperature less than 10 K above its temperature prior to the first short-circuit application.

Requirement

No visible deterioration may occur.

Result

The object passed the test.

5.5 Thermal short circuit test (conductor)

Standard and date

Standard IEC 60502-4, Table 5, test number 8
Test date 28 January 2015

Environmental conditions

Ambient temperature 11 °C

Characteristic test data

Conductor material Aluminum
Cross section conductor 185 mm²
Maximum short circuit conductor temperature 250 °C

First short circuit application

Start temperature of test object (measured value) 13,5 °C
Selected duration of short circuit current 1 s
Calculated short circuit current 22,5 kA
Thermal current, three phase 22,7 kA
Duration 1,06 s


Second short circuit application

Start temperature of test object (measured value) 13,5 °C
Selected duration of short circuit current 1 s
Calculated short circuit current 22,5 kA
Thermal current, three phase 22,7 kA
Duration 1,05 s

Procedure

Two short-circuits shall be applied to raise the conductor temperature to the maximum permissible short-circuit temperature of the cable within 5 s. Between the two short-circuits, the test loop shall be allowed to cool to a temperature less than 10 K above its temperature prior to the first short-circuit.

Test circuit S01

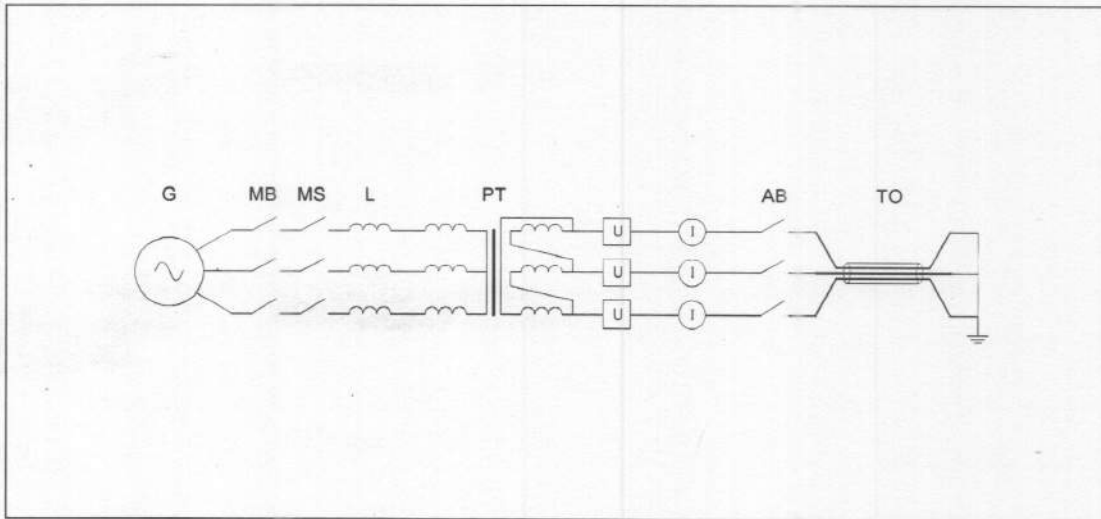



G = Generator	TO = Test Object	U = Voltage Measurement to earth
MB = Master Breaker	L = Reactor	I = Current Measurement
MS = Make Switch		
PT = Power Transformer		

Supply		
Power	MVA	47,2
Frequency	Hz	50
Phase(s)		3
Voltage	kV	2,2
Current	kA	22
Impedance	Ω	0,033
Power factor		< 0,1
Neutral		Not earthed

Load	
Short-circuit point	Earthed

5.6 Test results and oscillograms

Thermal short-circuit test

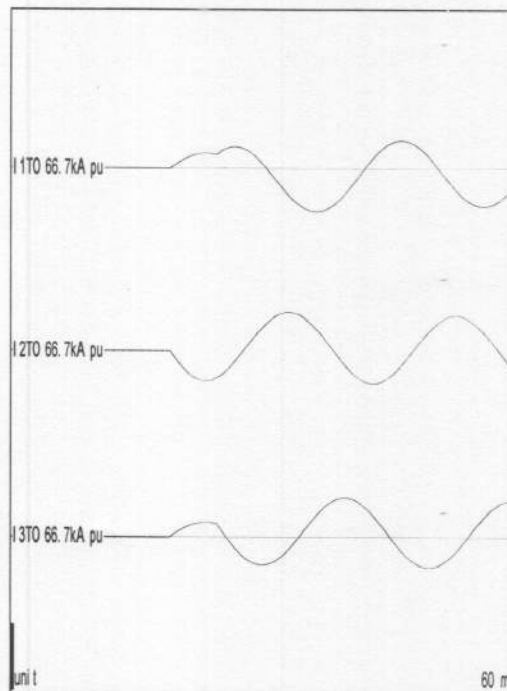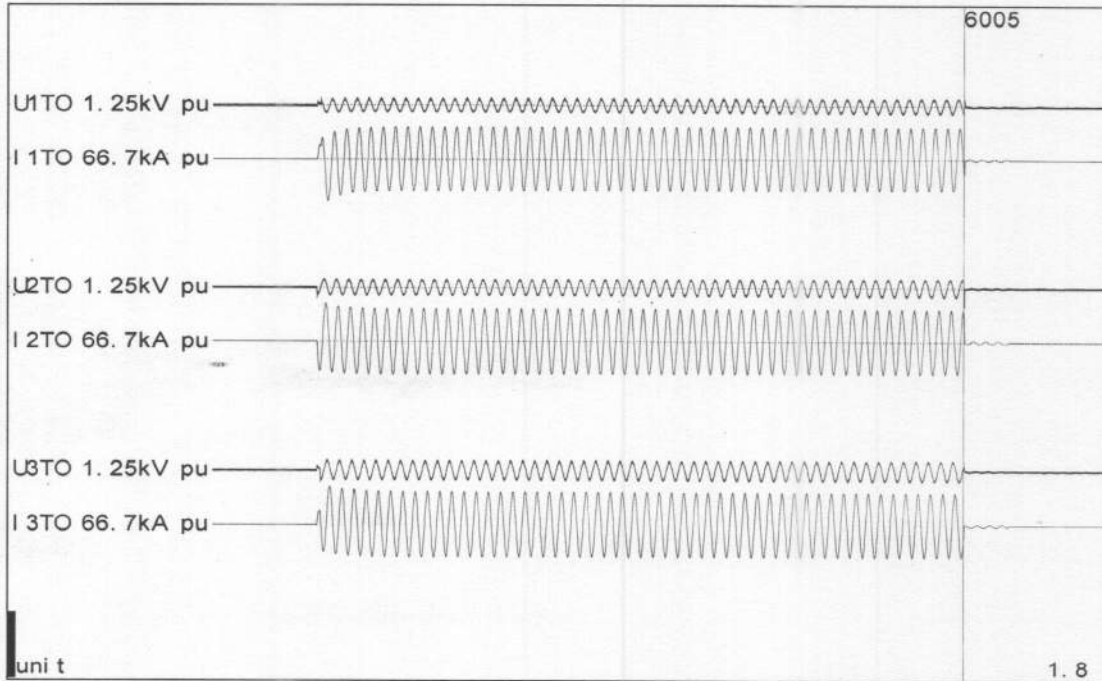



Test number: 150128-6005

Phase		-	-	-
Peak value of current	kA	-42,6	38,7	38,1
Symmetrical current, beginning	kA	23,0	23,5	23,3
Symmetrical current, middle	kA	22,7	23,1	22,8
Symmetrical current, end	kA	22,5	22,9	22,7
Symmetrical current, average	kA	22,8	23,3	22,1
Average current, three phase	kA	22,7		
Current duration	s	1,05	1,05	1,05
Thermal equivalent		22,5 kA during 1,06 s		

Ambient temperature 13,5 °C

Remarks:

Thermal short-circuit test

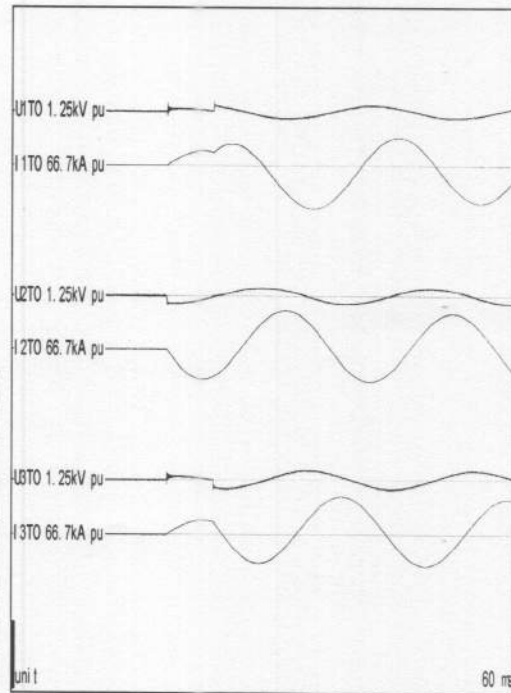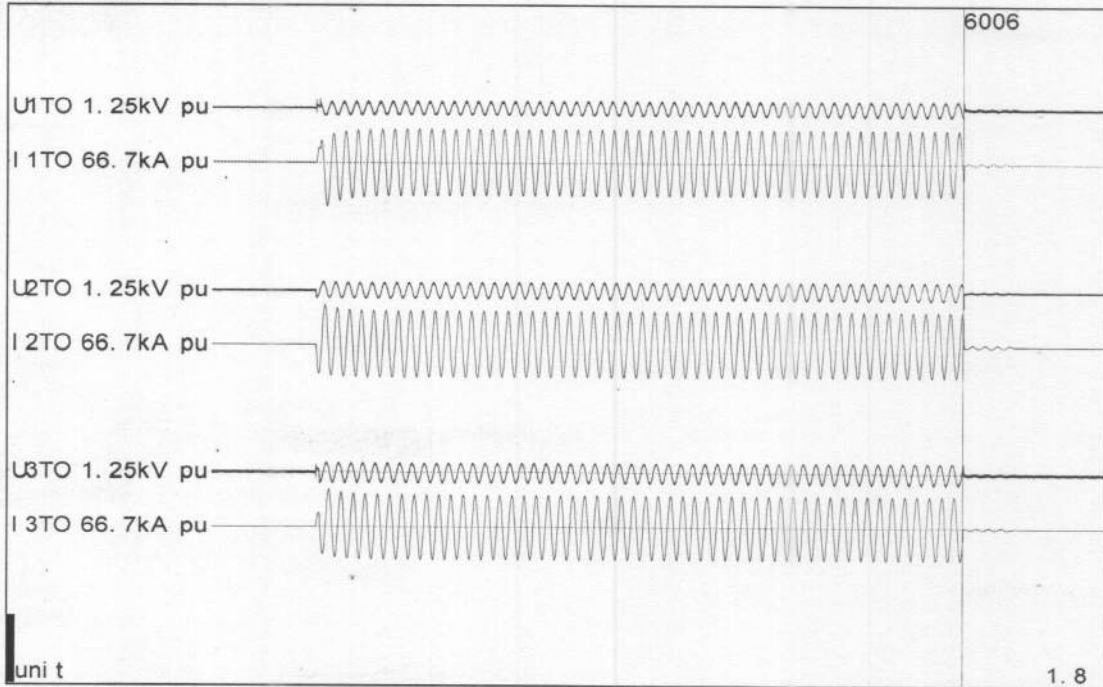

Test number: 150128-6006

Phase		-	-	-
Peak value of current	kA	-42,3	38,6	37,9
Symmetrical current, beginning	kA	23,0	23,4	23,2
Symmetrical current, middle	kA	22,6	23,0	22,7
Symmetrical current, end	kA	22,5	22,9	22,6
Symmetrical current, average	kA	22,8	23,2	22,0
Average current, three phase	kA	22,7		
Current duration	s	1,05	1,05	1,05
Thermal equivalent		22,5 kA during 1,10 s		

Ambient temperature 13,5 °C

Remarks:

5.7 **Condition / inspection after test**

Requirement

No visible deterioration may occur.

Result

No visible change. No visible damage.
The object passed the test.

5.8 Impulse voltage at ambient temperature

Standard and date

Standard IEC 60502-4, Table 5, test number 10

Test date 29 January 2015

Environmental conditions

Ambient temperature 20 °C

Characteristic test data

Temperature of test object 20 °C

Specified test voltage 95 kV

Testing arrangement		Polarity	Voltage applied (% of test voltage)	No. of impulses	See figure on next pages
Voltage applied to	Earthed				
Conductor 1 test loop 3	Metal screens and conductor 2 and 3	Positive	50	1	1 (waveshape)
			65	1	2
			80	1	2
			100	10	3 and 4
Conductor 1 test loop 3	Metal screens and conductor 2 and 3	Negative	50	1	5 (waveshape)
			65	1	6
			80	1	6
			100	10	7 and 8
Conductor 2 test loop 3	Metal screens and conductor 1 and 3	Positive	50	1	9 (waveshape)
			65	1	10
			80	1	10
			100	10	11 and 12
Conductor 2 test loop 3	Metal screens and conductor 1 and 3	Negative	50	1	13 (waveshape)
			65	1	14
			80	1	14
			100	10	15 and 16
Conductor 3 test loop 3	Metal screens and conductor 1 and 2	Positive	50	1	17(waveshape)
			65	1	18
			80	1	18
			100	10	19 and 20
Conductor 3 test loop 3	Metal screens and conductor 1 and 2	Negative	50	1	21 (waveshape)
			65	1	22
			80	1	22
			100	10	23 and 24

Note

On request of the client the applied LI voltage was 95 kV instead of 75 kV.

Requirement

Each core of the cable and accessory shall withstand without failure 10 positive and 10 negative voltage impulses.

Result

The object passed the test.

5.9 AC voltage dry

Standard and date

Standard IEC 60502-4, Table 5, test number 11

Test date 29 January 2015

Environmental conditions

Ambient temperature 20 °C

Temperature of test object 20 °C

Testing arrangement		Voltage applied, 50 Hz		Duration (min)
Voltage applied to	Earth connected to	... x U ₀	(kV)	
Conductor 1,2 and 3 of test loop 3	Metal screens	2,5	16	15

Requirement

No breakdown or flashover shall occur.

Result

The object passed the test.

5.10 Examination

Standard and date

Standard IEC 60502-4, Table 5, test number 14

Test date 5 February 2015

Environmental conditions

Ambient temperature 20 °C

Temperature of test object 20 °C

Test loop	Observations ¹⁾
3.	None of the following has been detected: <ul style="list-style-type: none">- cracking in the filling media and/or tape or tube components- a moisture path across a primary seal- corrosion and/or tracking and/or erosion- leakage of any insulating material

1) Photographs of the examination are presented on the next page

Result

The results are for information only.

6 TEST SEQUENCE 1.4 (ONE INDOOR TERMINATION)

6.1 Humidity

Standard and date

Standard IEC 60502-4, Table 5, test number 12

Test dates 28 January to 9 February 2015

Environmental conditions

Ambient temperature 20-22 °C

Temperature of test object 20-22 °C

Characteristic test data

Leakage current protection (I_{max}) $1 \pm 0,1$ A

Conductivity 70 ± 10 mS/m

Rate of flow $0,4 \pm 1$ l/h/m³

Testing arrangement		Applied Voltage, 50 Hz		Duration (h)
Voltage applied to conductor	Earth connected to	... x U_0	(kV)	
1, 2 and 3	Metallic screen	1,25	8	300

Requirement

No breakdown or flashover, no more than 3 trips, no substantial damage of the insulation shall occur.

Result

There was no breakdown or flashover, no trips.

After the humidity test, on two of the three phases loss of dielectric quality occurred due to tracking, erosion and some splitting of material on the break-out.

6.2 Examination

Standard and date

Standard IEC 60502-4, Table 5, test number 14
Test date 10 February 2015

Environmental conditions

Ambient temperature 20 °C

Characteristic test data

Temperature of test object 20 °C


object	observations
test loop 4	None of the following has been detected: <ul style="list-style-type: none">- cracking in the filling media and/or tape or tube components- a moisture path across a primary seal- corrosion and/or tracking and/or erosion- leakage of any insulating material

Result

For information only.

7

DRAWING

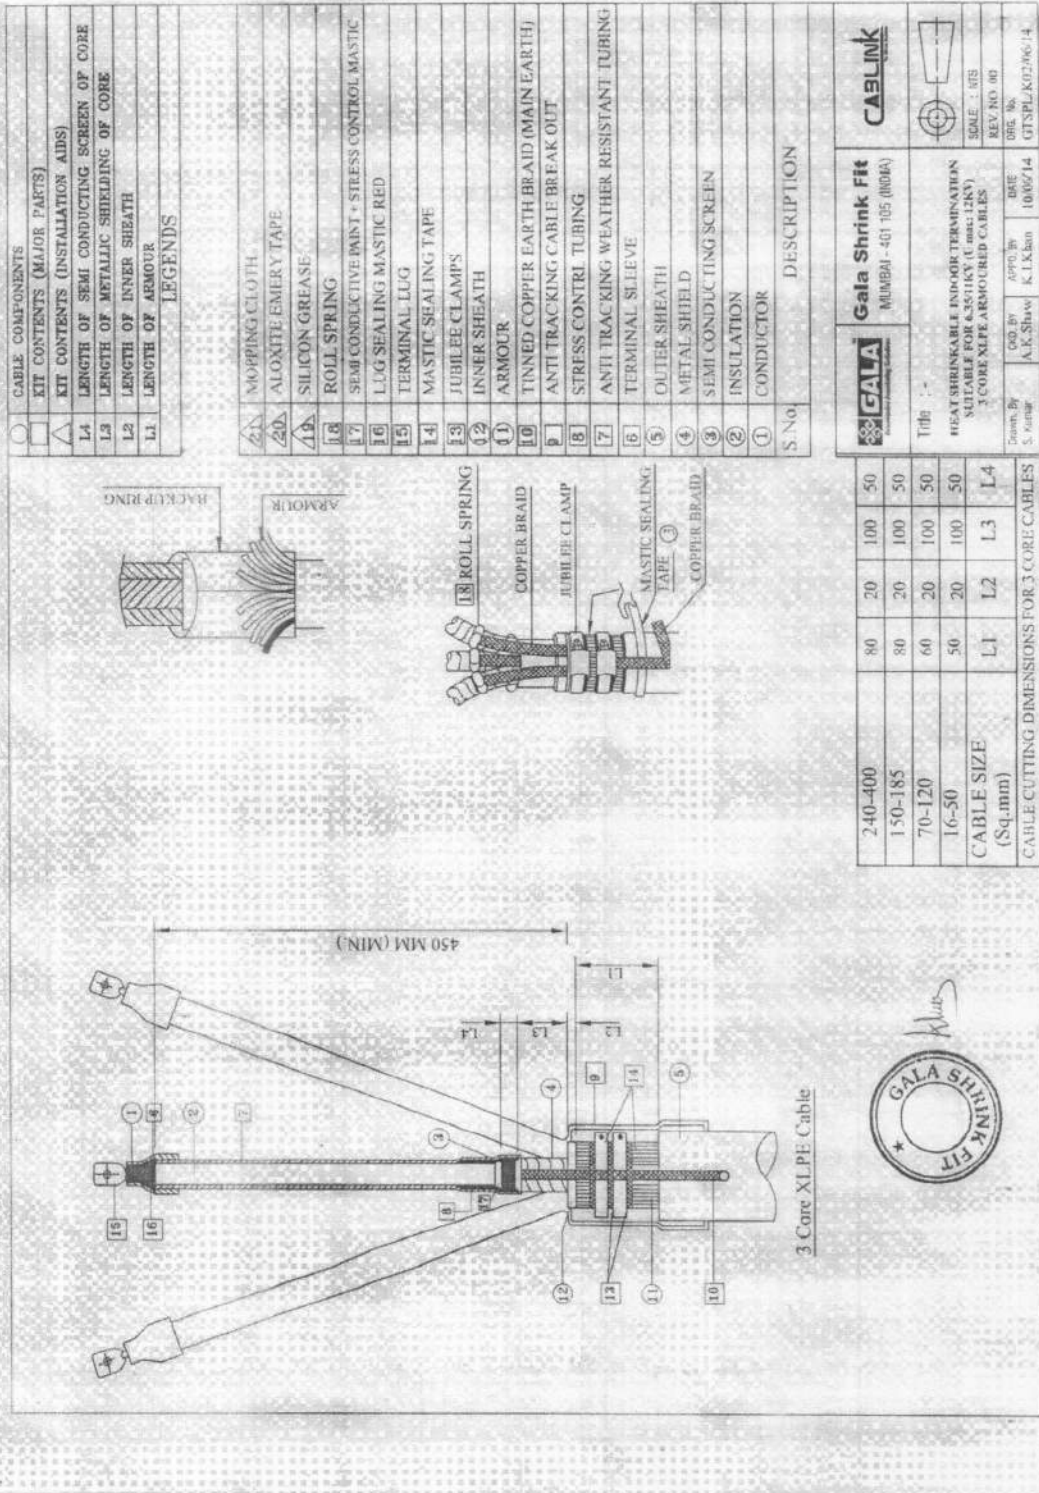

○	CABLE COMPONENTS
□	KIT CONTENTS (MAJOR PARTS)
△	KIT CONTENTS (INSTALLATION AIDS)
L4	LENGTH OF SEMI CONDUCTING SCREEN OF CORE
L3	LENGTH OF METALLIC SHIELDING OF CORE
L2	LENGTH OF INNER SHEATH
L1	LENGTH OF ARMOUR
	LEGENDS

△	MOPPING CLOTH
△	ALOXITE EMERY TAPE
△	SILICON GREASE
△	ROLL SPRING
△	SEMI CONDUCTIVE PAINT + STRESS CONTROL MASTIC
△	LUG SEALING MASTIC RED
△	TERMINAL LUG
△	MASTIC SEALING TAPE
△	JUBILEE CLAMPS
△	INNER SHEATH
△	ARMOUR
△	TINNED COPPER EARTH BRAID (MAIN EARTH)
△	ANTI TRACKING CABLE BREAK OUT
△	STRESS CONTROL TUBING
△	ANTI TRACKING WEATHER RESISTANT TUBING
△	TERMINAL SLEEVE
△	OUTER SHEATH
△	METAL SHIELD
△	SEMI CONDUCTING SCREEN
△	INSULATION
△	CONDUCTOR
S.No	DESCRIPTION

GALA	Gala Shrink Fit	CABLINK
MUMBAI - 401 105 (INDIA)	MUMBAI - 401 105 (INDIA)	
Drawn By S. Vargha	Checked By A.S. Shaw	DATE 10/09/14
Scale : -	Scale : 80%	REV. NO. 00
HEAT SHRINKABLE END-OFF TERMINATION SUITABLE FOR 6.35(1/4") (U. max. 12KV) 3 CORE XLPE ARMOURED CABLES		
GTS/PL/401/06/14		

240-400	80	20	100	50
150-185	80	20	100	50
70-120	60	20	100	50
16-50	50	20	100	50
CABLE SIZE (Sq.mm)	L1	L2	L3	L4

CABLE CUTTING DIMENSIONS FOR 3 CORE CABLES

3 Core XLPE Cable

GALA SHRINK FIT

8 MEASUREMENT UNCERTAINTY

The measurement uncertainties in the results presented are as specified below unless otherwise indicated.

Measurement	Measurement uncertainty
Dielectric tests and impulse current tests:	
- peak value	≤ 3%
- time parameters	≤ 10%
Capacitance measurement	0,3%
Tan δ measurement	± 0,5% ± 5 × 10 ⁻⁵
Partial discharge measurement:	
- < 10 pC	2 pC
- 10 to 100 pC	5 pC
- > 100 pC	20%
Measurement of impedance AC-resistance measurement	≤ 1%
Measurement of losses	≤ 1%
Measurement of insulation resistance	≤ 10%
Measurement of DC resistance:	
- 1 to 5 μΩ	1%
- 5 to 10 μΩ	0,5%
- 10 to 200 μΩ	0,2%
Radio interference test	2 dB
Calibration of current transformers	2,2 × 10 ⁻⁴ I _p /I _n and 290 μrad
Calibration of voltage transformers	1,6 × 10 ⁻⁴ U _p /U _n and 510 μrad
Measurement of conductivity	5%
Measurement of temperature:	
- -50 to -40 °C	3 K
- -40 to 125 °C	2 K
- 125 to 150 °C	3 K
Tensile test	1%
Sound level measurement	type 1 meter as per IEC 60651 and ANSI S1,4,1971
Measurement of voltage ratio	0,1%